



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Premdor Entry Systems
One Premdor Drive
Dickson, TN 37055

Your application for Notice of Acceptance (NOA) of:

Entry SE Double Door w/sidelites-Outswing-Opaque-8'0" In a Wood Frame

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-1031.04
EXPIRES: 11/05/2006

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL CONDITIONS BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 12/11/2001

APPROVED: December 11, 2001

EXPIRES: November 5, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1** This **renews** Notice of Acceptance (NOA) No. **00-0720.08**, which was issued on November 09, 2000. It renews the approval of a residential insulated steel door, as described in Section 2 of this NOA, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1** The Series **"Entergy" Outswing Opaque Double Residential Insulated Steel Door w/ Sidelites** and its components shall be constructed in strict compliance with the following document: Drawing No **31-1034-EM-O**, Sheets 1 through 6 of 6, titled "Premdor (Entergy Metal Edge) Double Door w/ Sidelites in Wood Frame w/ Bumper Threshold – 8'0" Height (Outswing)," prepared by manufacturer, dated 6/15/98 and revised on 7/27/01, bearing the Miami-Dade County Product Control renewal stamp with the NOA number and expiration date by the Miami-Dade County Product Control Division. This document shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1** This approval applies to single unit applications of pair of doors and single door with sidelites, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

4. INSTALLATION


- 4.1** The residential insulated steel door and its components shall be installed in strict compliance with the approved drawings.
- 4.2** Hurricane protection system (shutters):
Door Slab: The installation of this unit will not require a hurricane protective system.
Sidelites: The installation of these units will require a hurricane protective system.

5. LABELING

- 5.1** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1** Application for building permit shall be accompanied by copies of the following:
- 6.1.1** This Notice of Acceptance
- 6.1.2** Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3** Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

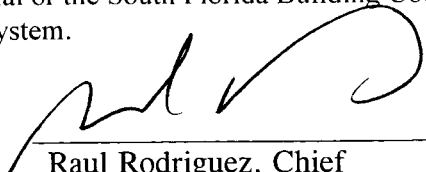

Raul Rodriguez, Chief
Product Control Division


APPROVED: December 11, 2001

EXPIRES: November 5, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS


1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE

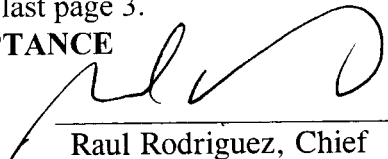

Raul Rodriguez, Chief
Product Control Division


PREMDOR (ENTERGY METAL EDGE) DOUBLE DOOR
WITH SIDELITES IN WOOD FRAMES
WITH BUMPER THRESHOLD-8'0" HEIGHT (OUTSWING)

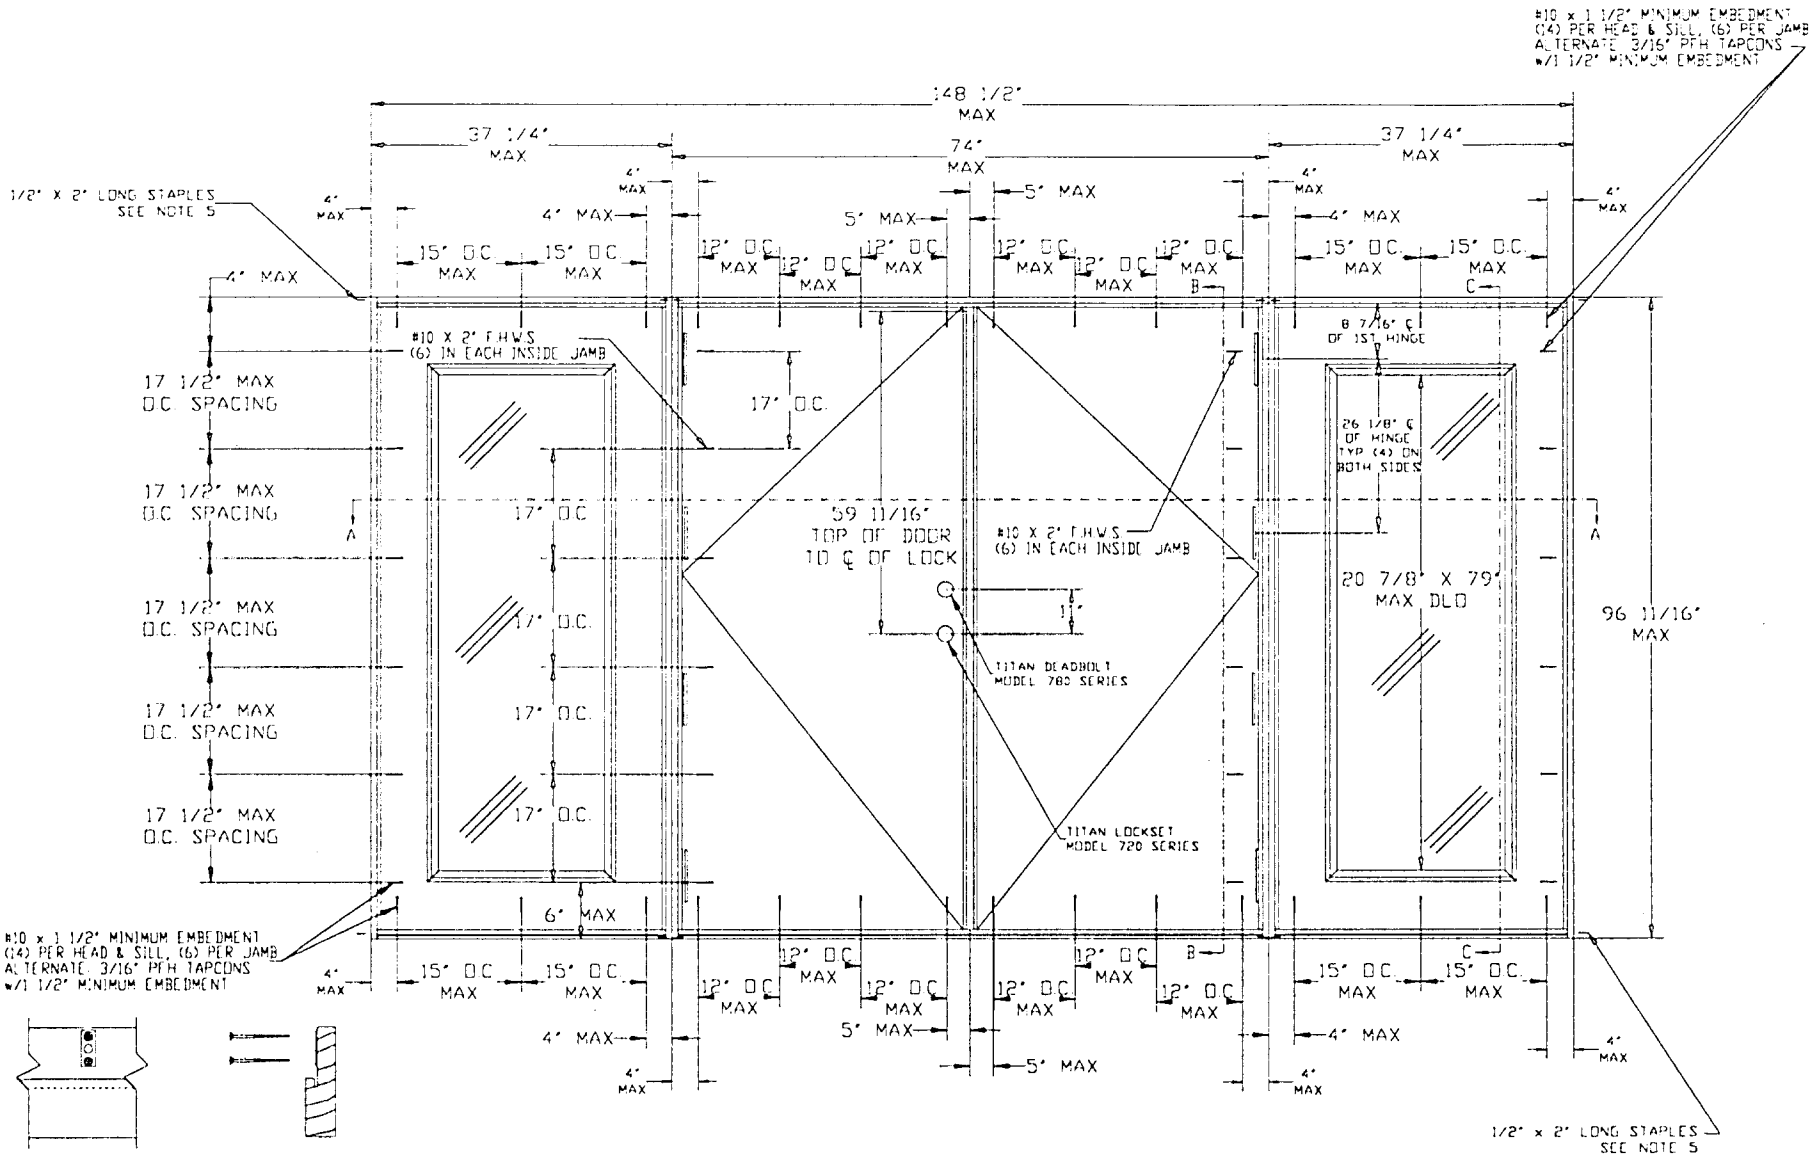


ATTACH ASTRAGAL THROW BOLT STRIKE PLATE TO THE HEADER AND THRESHOLD WITH #10 x 2" FLATHEAD SCREWS

NOTES:

- 1.) WOOD BUCKS BY OTHERS. MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- 2.) THE PRECEDING DRAWINGS ARE INTENDED TO QUALIFY THE FOLLOWING INSTALLATIONS.
A. WOOD FRAME CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY WOOD OPENING.
B. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY STRUCTURAL WOOD BUCK.
C. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED DIRECTLY TO CONCRETE OR MASONRY WITH OR WITHOUT A NON-STRUCTURAL ONE BY WOOD BUCK.
3. ALL ANCHORING SCREWS TO BE #10 WITH MINIMUM 1 1/2" EMBEDMENT INTO WOOD SUBSTRATE OR 3/16" PFH TAPCONS WITH 1 1/2" MINIMUM EMBEDMENT INTO MASONRY.
4. GLAZED UNIT MUST BE INSTALLED WITH "MIAMI-DADE COUNTY APPROVED" SHUTTERS
5. THREE STAPLES PER SIDE JAMB INTO HEADER ON SIDELITES AND DOOR, THREE STAPLES PER JAMB INTO THRESHOLD ON SIDELITES AND DOOR.
6. LATEX SEALANT TO BE APPLIED AT SIDE BY SIDE JAMBS AND SIDELITES.
7. DOOR/SIDELITE HEADER, DOOR/SIDELITE JAMBS, AND SIDELITE BASE CORNERS ARE COPED AND BUTTED
8. DOORS SHALL BE PRE-PAINTED WITH AN ACRYLIC LATEX WATER-BASED/ WATER-REDUCIBLE WHITE PRIMER WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.
9. FRAMES SHALL BE PRE-PAINTED WITH A WATER-BASED EPOXY PRIMER WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.

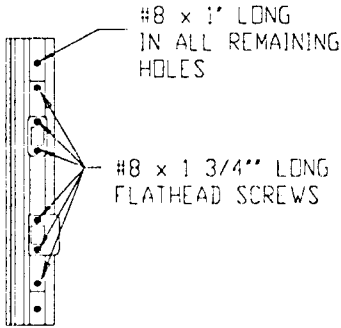

ASTRAGAL

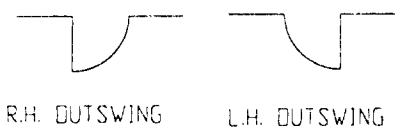

| DESIGN PRESSURE RATINGS | | |
|-------------------------|--|--|
| | WHERE WATER INFILTRATION REQUIREMENT IS NEEDED * | WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED |
| Positive | +48.3 psf | +48.3 psf |
| Negative | -48.3 psf | -48.3 psf |




PRODUCT RENEWED

ACCEPTANCE No. 01-1031.04

EXPIRATION DATE November 5, 2006

By  PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

| | | | | | |
|---|--|---|-------------------------------|---------------|----|
| LIMITS UNLESS NOTED, TRAC. : DEC. : ANG. : | | C | DADE COUNTY MODIFICATIONS | 7/27/01 | JD |
| EXTRUSIONS: UNLESS NOTED, STD. COML. DIM'S. | | B | ADDED PAGE 5 (DOOR OPTIONS) | 10-1-98 | RS |
| ENGINEER: | | A | ADD OTHER DOOR CONFIGURATIONS | 12/18/97 | RS |
| | | TR | REVISIONS | DATE | BY |
| DR. BY R.S. | | PART NAME: ENTERGY (METAL EDGE) DOUBLE DOOR W/SIDELITES | | SCALE: N.T.S. | |
| DATE 6-15-98 | | MATERIAL: | | | |
| PREMDOR ENTRY SYSTEMS | | | 31-1034-EM-0 | | |
| 911 E. JEFFERSON PITTSBURG, KS. 66762 | | | SHEET 1 OF 6 | | |
| | | | REVISION LETTER C | | |

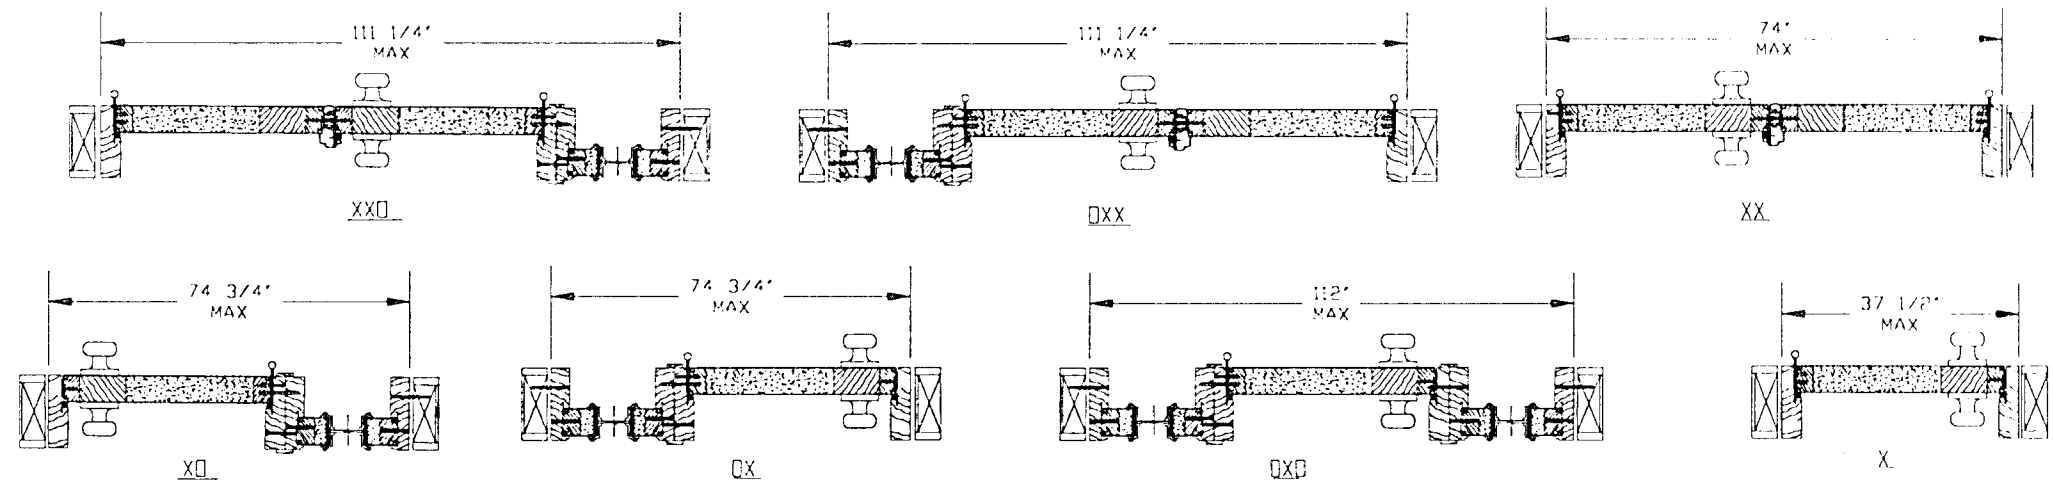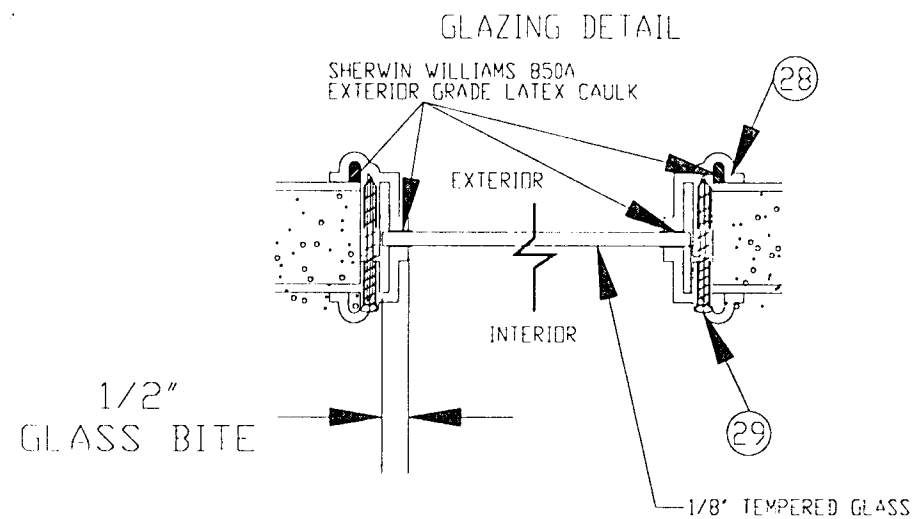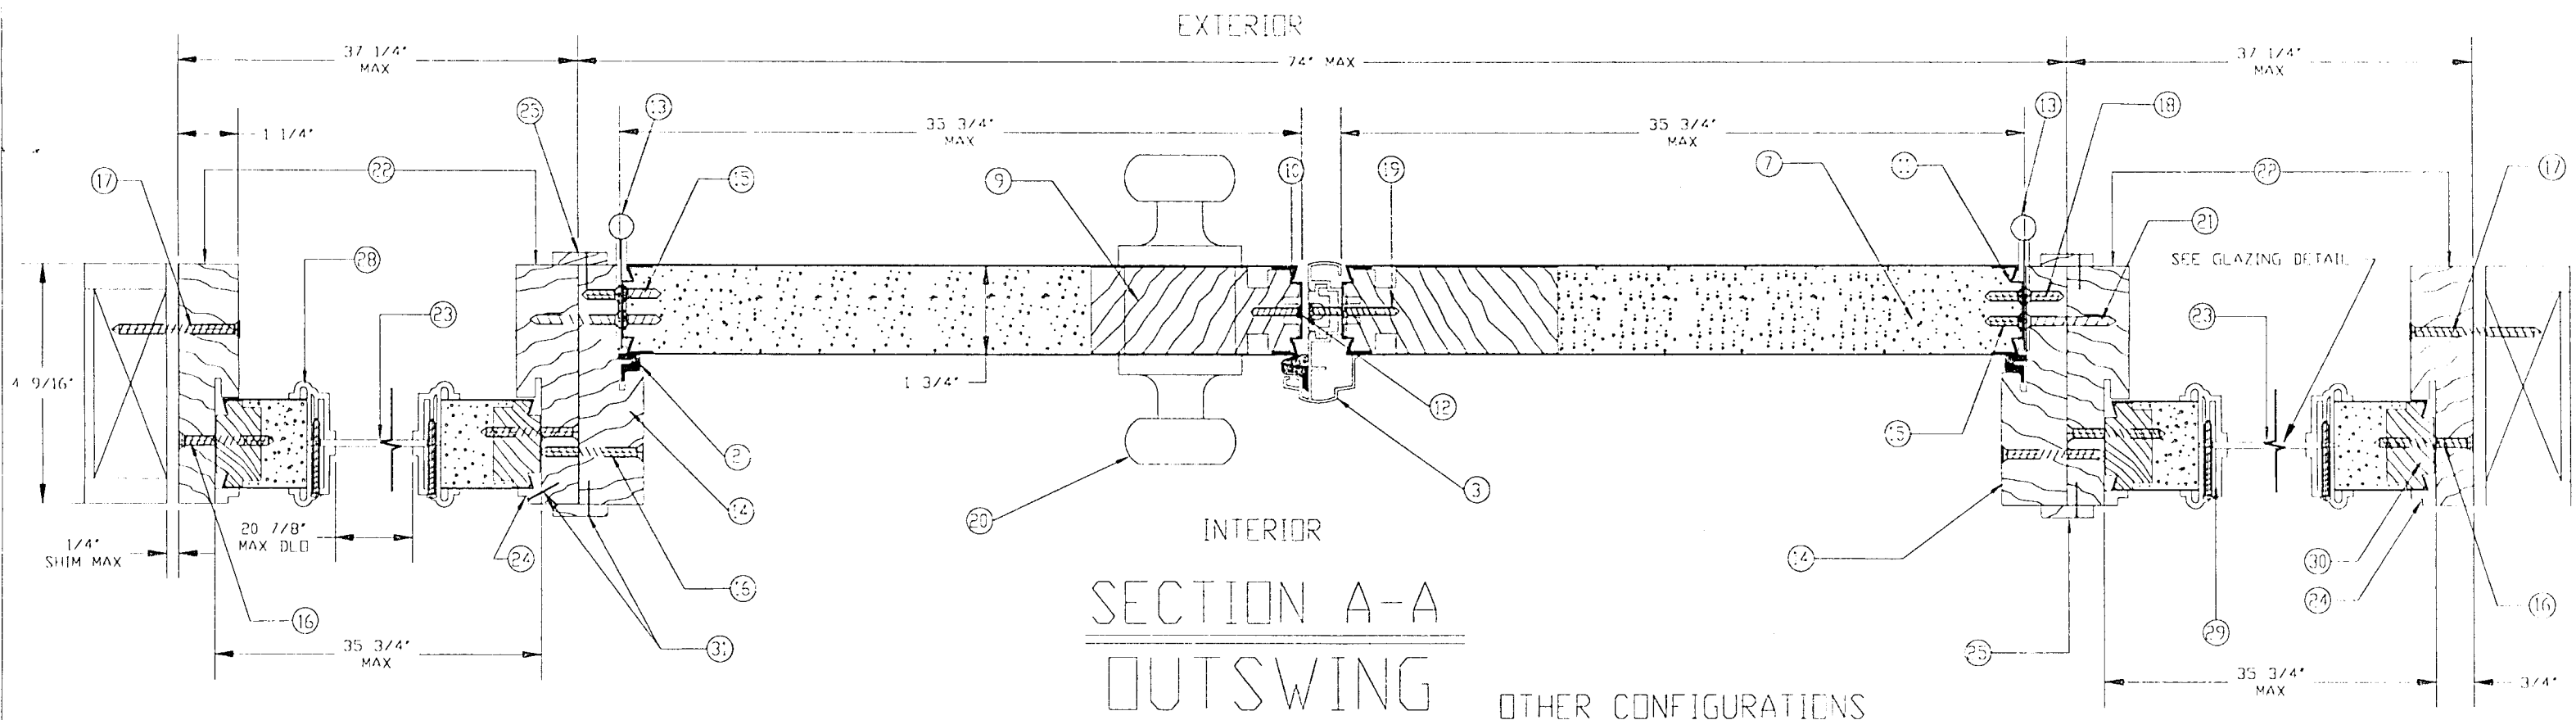

PRODUCT RENEWED

ACCEPTANCE No. 01-1031.04


EXPIRATION DATE November 5, 2006

By *[Signature]*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

| | | | |
|---|---------------------------|-------------------|----|
| C | DATE COUNTY MODIFICATIONS | 8/5/01 | JD |
| B | WAS SHEET 2 OF 4 | 8/13/98 | RS |
| A | RE-DRAW | 6/15/98 | RS |
| LTR | REVISIONS | DATE | BY |
| PART NAME: ENERGY DOOR W/SIDE LITES (A-A) | | SCALE: NTS | |
| PREMDOR ENTRY SYSTEMS | | 31-1034-EM II | |
| 511 E JEFFERSON | | SHEET 2 OF 6 | |
| PITTSBURG, KS 66762 | | REVISION LETTER C | |

MATERIALS LIST

| ITEM NO | DESCRIPTION | PART NUMBER | COMMENTS |
|---------|--|--|---|
| ① | WOOD HEAD JAMB | EM-14 | 1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT |
| ② | COMPRESSION WEATHERSTRIP | EM-25 | LOCKSCREEN BRAND LOXSEAL 9650 (BRUNZ) |
| ③ | ALUMINUM ASTRAGAL | EM-12 | PREMDOR BRAND OR EQUIVALENT - 5/8" ALUMINUM ASTRAGAL |
| ④ | ALUMINUM-BUMPER THRESHOLD | EM-15 | PREMDOR BRAND OR EQUIVALENT 1 1/4" x 4 9/16" |
| ⑤ | TOP CHANNEL | EM-08 | PREMDOR BRAND - 1 11/16" - 20 GA STEEL |
| ⑥ | STEEL SKIN | 24 ga (100 - 100 - 100) | MIN. YIELD STRENGTH 35,000 PSI MIN. THICKNESS PER TENSILE TEST REPORT IS 0.01" |
| ⑦ | POLYURETHANE FOAM CORE | BASE FOAM - DENSITY 2.0 TO 2.5 lbs/cu' | |
| ⑧ | BOTTOM CHANNEL | EM-07 | PREMDOR BRAND - 1 11/16" - 20 GA STEEL |
| ⑨ | WOOD LOCK BLOCK | EM-09 | 4' X 9 1/2' MTL. TO BE PINE OR EQUIVALENT |
| ⑩ | STRIKE STILE | EM-06 | PREMDOR BRAND - 1 11/16" - 20 GA STEEL |
| ⑪ | HINGE STILE | EM-05 | PREMDOR BRAND - 1 11/16" - 20 GA STEEL |
| ⑫ | LOCK PREP FILLER PLATE | EM-10 | PREMDOR BRAND - .050" THICK - MTL. TO BE POLYETHYLENE |
| ⑬ | 4"x4" HINGE | EM-16 | HAGER BRAND HINGE OR EQUIVALENT - .097" THICK (STEEL) |
| ⑭ | WOOD HINGE JAMB | EM-13 | 1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT |
| ⑮ | #10-24 x 1/2" F.H.W.S. | | (4) SCREWS PER HINGE INTO DOOR |
| ⑯ | #10 X 2" F.H.W.S. | | (6) SCREWS THROUGH HINGE JAMB INTO SIDELITE JAMB, 8" DOWN FROM TOP, MAX 17" O.C. THEREAFTER (6) SCREWS THROUGH EACH SIDELITE JAMB INTO SIDELITE, 4" DOWN FROM TOP, MAX 17" O.C. THEREAFTER |
| ⑰ | #10 F.H.W.S. W/MINIMUM 1 1/2" EMBEDMENT OR 3/16" PER TAPEDS W/MINIMUM 1 1/2" EMBEDMENT | | REFER TO ELEVATION VIEW, FOR # OF SCREWS USED AND LOCATIONS |
| ⑱ | #10 X 3/4" F.H.W.S. | | (2) SCREWS PER HINGE INTO JAMB |
| ⑲ | #8 X 2" F.H.W.S. | | (2) SCREWS AT EACH STRIKE PLATE |
| ⑳ | LOCKSET | | TITAN LOCK 720 SERIES, TITAN DEADBOLT 1780 SERIES |
| ㉑ | #10 X 1 3/4" F.H.W.S. | | (2) SCREWS PER HINGE INTO JAMB |
| ㉒ | WOOD SIDELITE JAMB | EM-18 | 1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT |
| ㉓ | 22" X 80" SINGLE PANEL GLASS | EM-19 | TEMPERED GLASS IN POLYPROPYLENE FRAME - DC 1643 (SIDE BY SIDE) 1/8" CLEAR TEMPERED GLASS |
| ㉔ | SIDELITE TRIM (WOOD) | EM-20 | 5/16" X 1 1/2" MTL. TO BE PINE OR EQUIVALENT |
| ㉕ | WOOD CASING | EM-21 | 1/8" X 1" MTL. TO BE PINE OR EQUIVALENT - ITEMS ARE MOLDINGS USED FOR "SIDE BY SIDE" JAMBS" AS MULLIONS |
| ㉖ | WOOD SIDELITE HEAD JAMB | EM-22 | 1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT |
| ㉗ | WOOD SIDELITE BASE | EM-23 | 1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT |
| ㉘ | POLYPROPYLENE LITE FRAME | DC-1643, DCL-2 | HP Polypropylene by TIDL |
| ㉙ | #6 X 1 1/2" PAN HEAD SCREWS | | 18 PER FRAME SCREW SPACING: TO BE 3" IN FROM EACH CORNER AND NOT TO EXCEED 14" O.C. THEREAFTER |
| ㉚ | SIDELITE STILES | EM-26 | 15/16" X 1 11/16" MTL. TO BE PINE OR EQUIVALENT |
| ㉛ | PIN NAIL | | 3/4" LONG NAIL, 4" IN FROM END, MAX 8" O.C. THEREAFTER, USED ON MULLIONS AND TRIM |

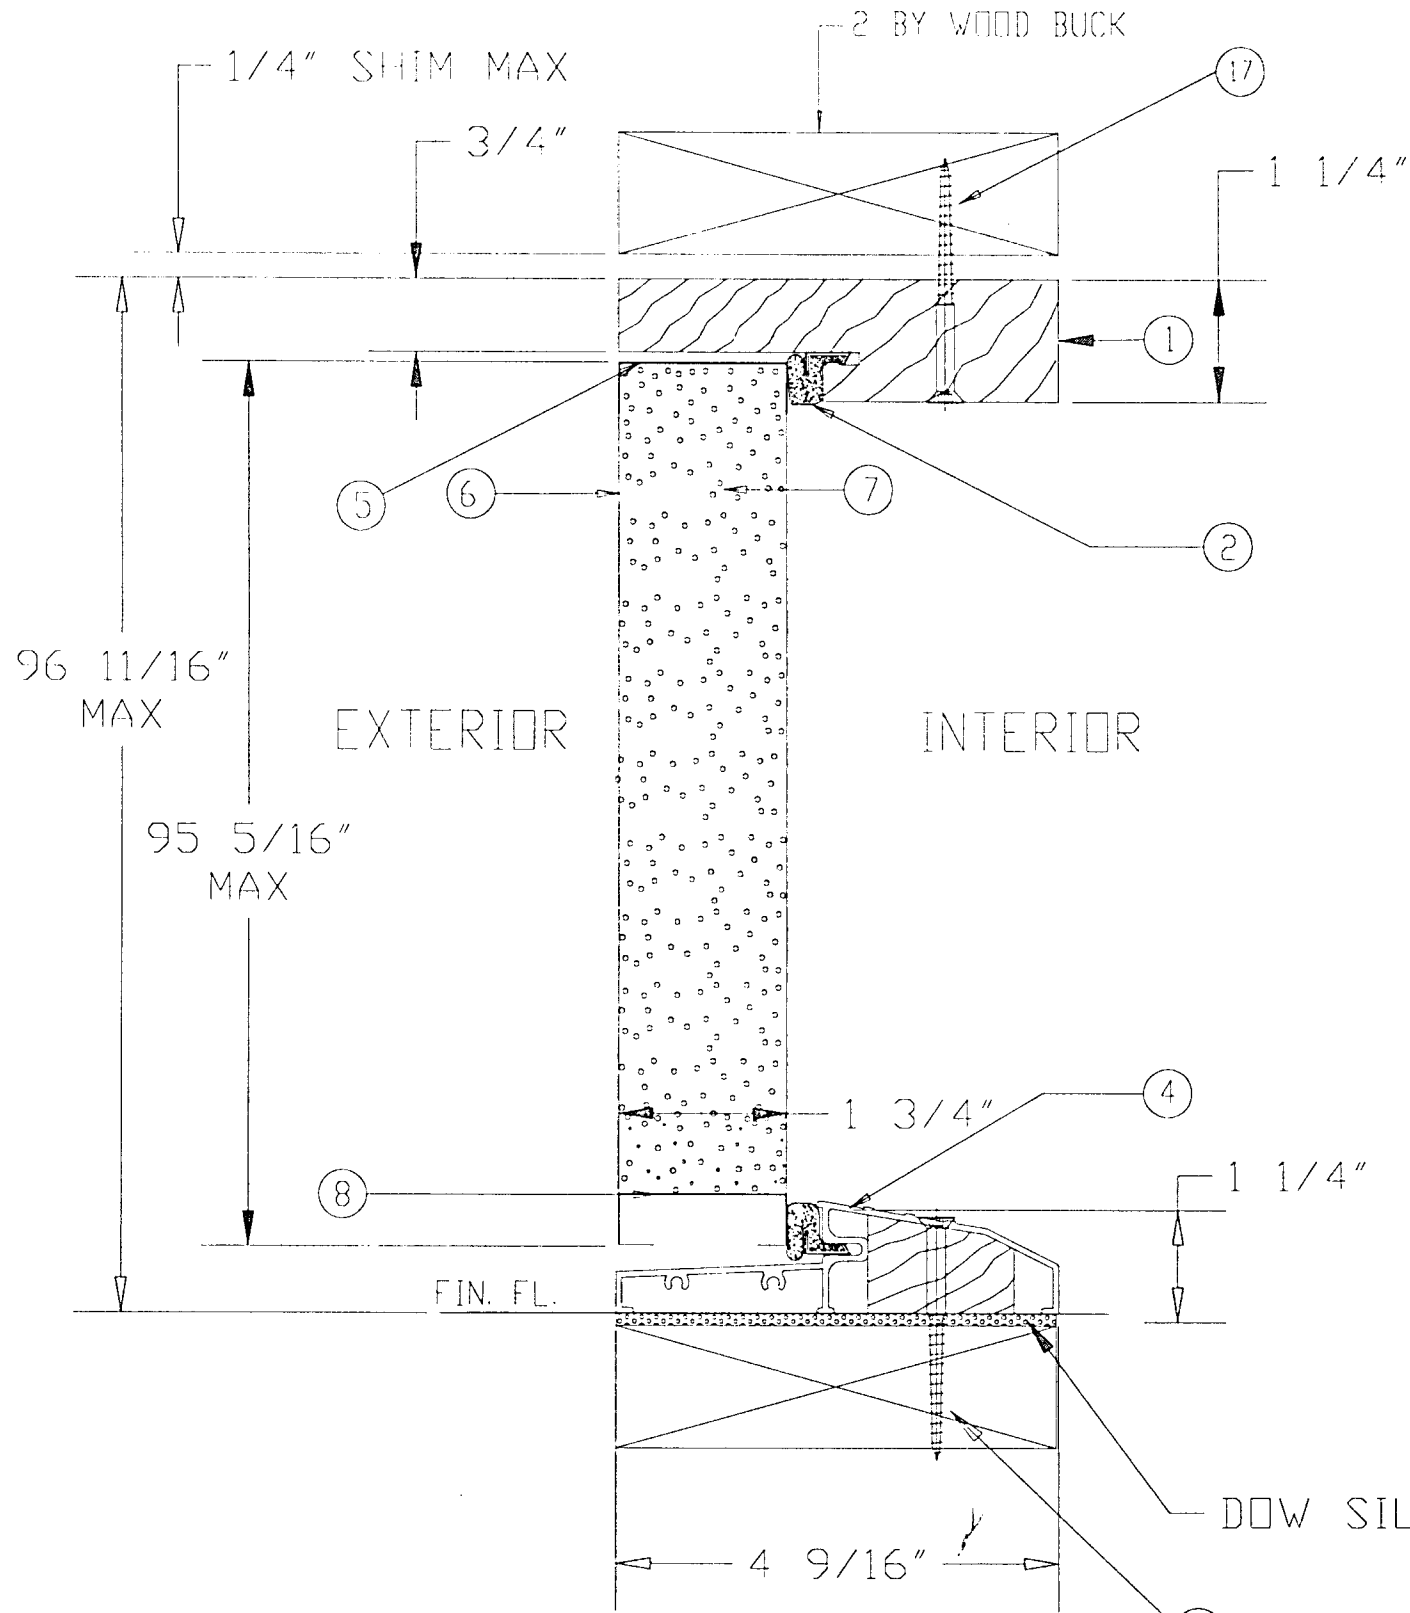

SECTION B-B

DOW SILICONE #995

PRODUCT RENEWED

ACCEPTANCE No. 01-1031.04

EXPIRATION DATE Summer 5, 2006

By [Signature]

PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.

ENGINEER: [Signature]
DR. BY R.S. DATE 7-29-97


PREMDOR ENTRY SYSTEMS
911 E. JEFFERSON
PITTSBURG, KS. 66762

| D | DADE COUNTY MODIFICATIONS | 8/1/01 | JJ |
|------|---------------------------|---------|----|
| C | ADDED TEST RESULTS | 9/13/99 | RS |
| B | ADDED SHEET 5 | 8/13/98 | RS |
| A | REDRAWN | 6/15/98 | RS |
| LTR. | REVISIONS | DATE | BY |

PART NAME: ENTERGY STEEL EDGE DOOR (B-B)
SCALE:

31-1034-EM-0
SHEET 3 OF 6

REVISION LETTER D

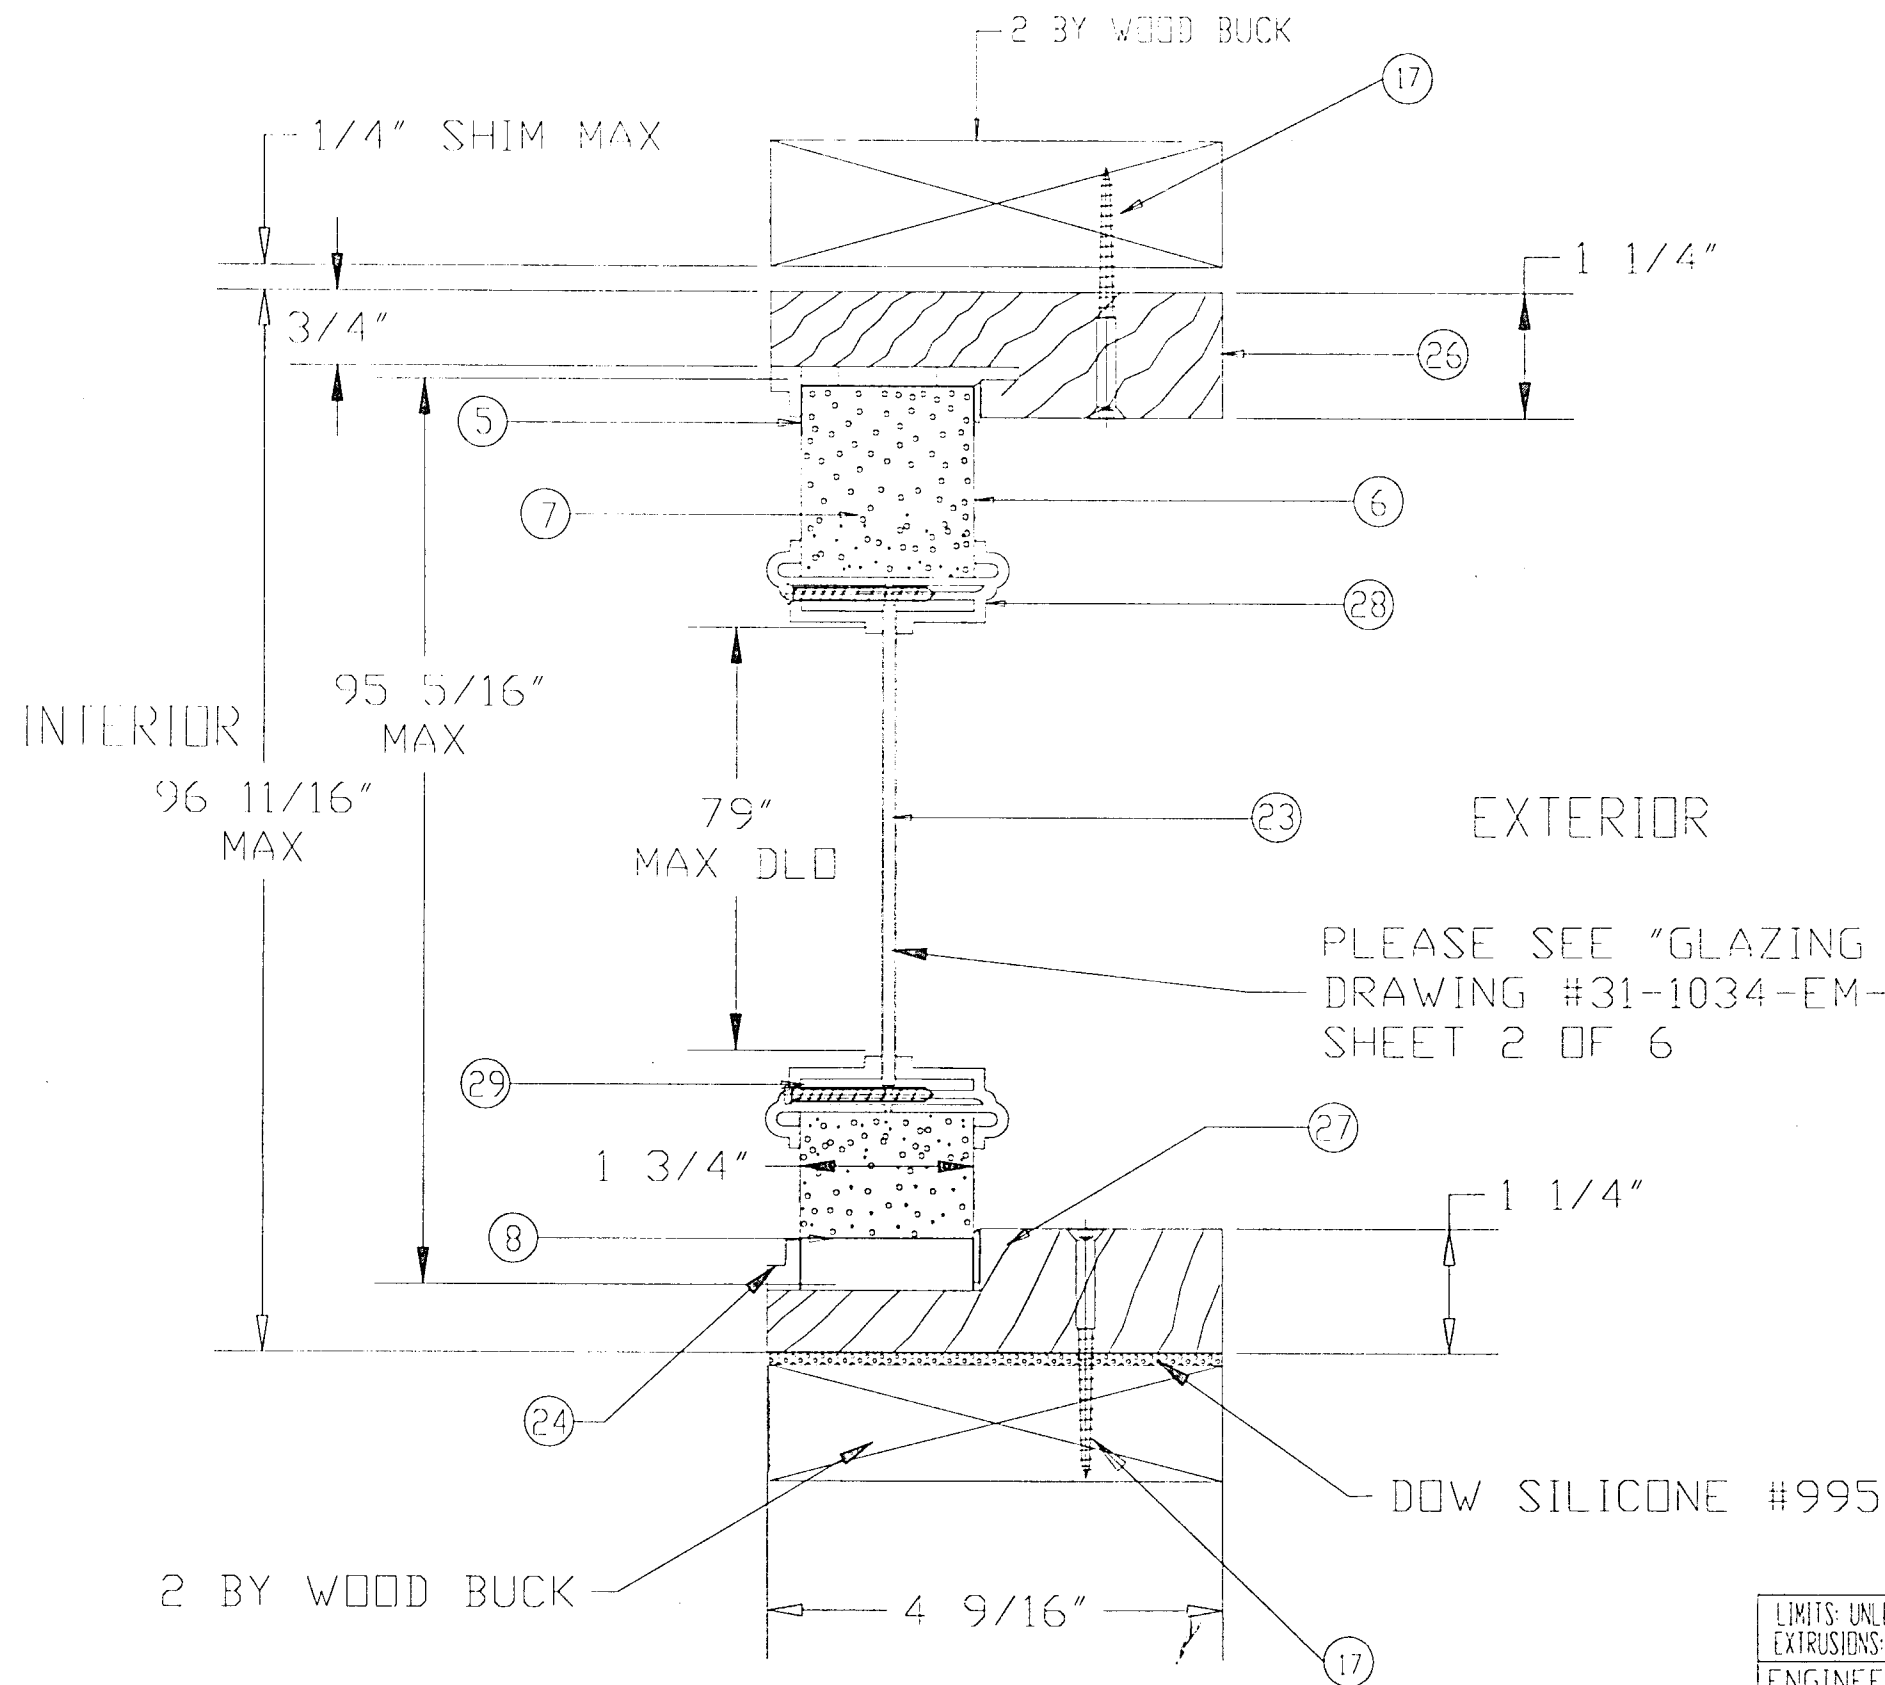

SECTION C-C

PLEASE SEE "GLAZING DETAIL"
DRAWING #31-1034-EM-□
SHEET 2 OF 6

DOW SILICONE #995

PRODUCT RENEWED

ACCEPTANCE No. 01-1031.04

EXPIRATION DATE November 5, 2006

By 
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

| | | | |
|------|---------------------------|---------|------|
| D | DADE COUNTY MODIFICATIONS | 8/5/01 | JD |
| C | MATERIAL WAS POLYSTYRENE | 9/13/99 | RS |
| B | ADDED SHEET 5 | 8/13/98 | RS |
| A | REDRAWN | 6/15/98 | R.S. |
| LTR. | REVISIONS | DATE | BY |

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S

ENGINEER:

DR. BY R.S. DATE 7-29-97

PREMDOR ENTRY SYSTEMS

911 E. JEFFERSON
PITTSBURG, KS. 66762

PART NAME: ENTERGY METAL EDGE SIDELITE (C-C)


MAT'L: SCALE:

31-1034-EM-□


SHEET 4 OF 6

REVISION LETTER D


OTHER DOOR CONFIGURATIONS

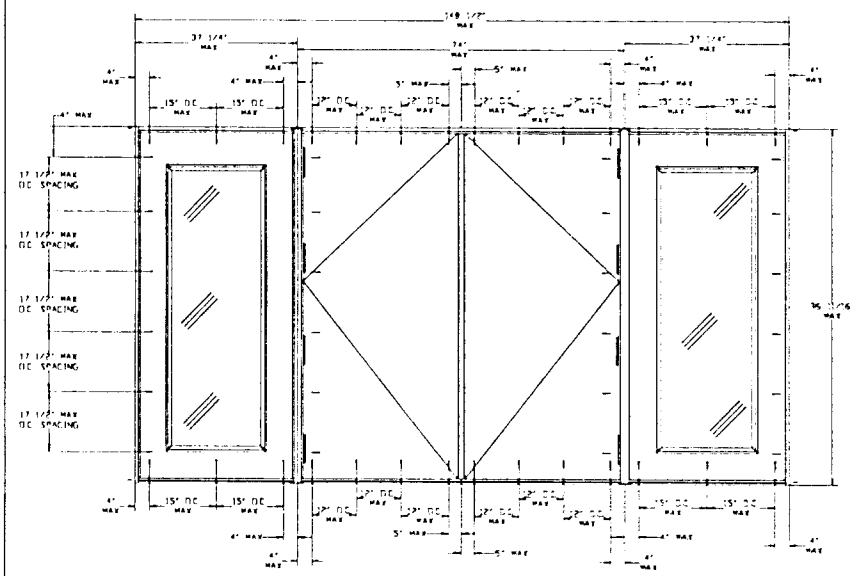


□XX□

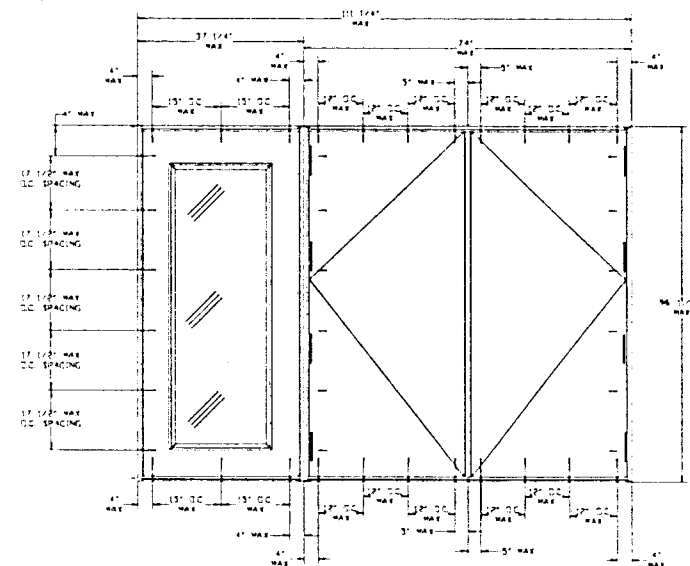


□XX

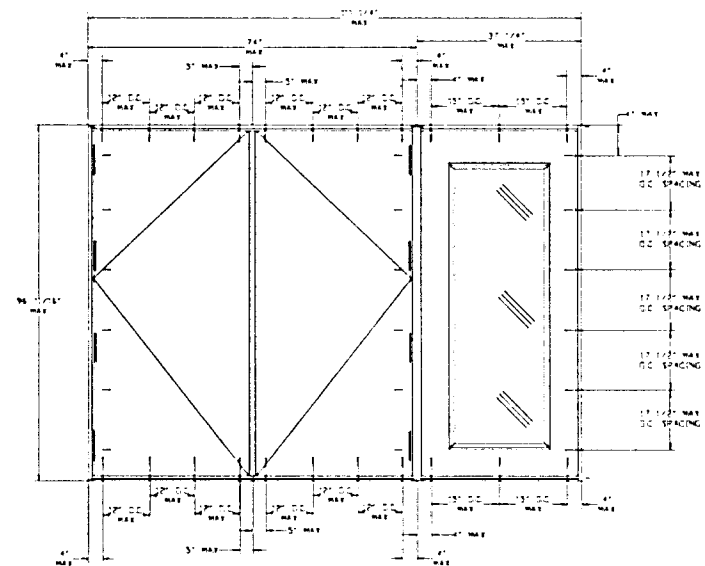


XX□

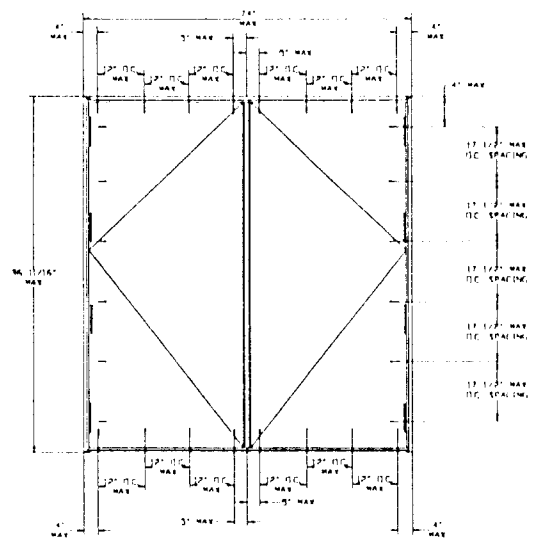


XX

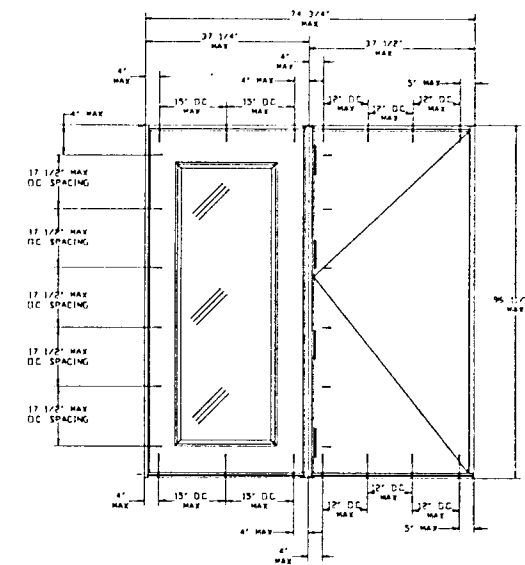


□X

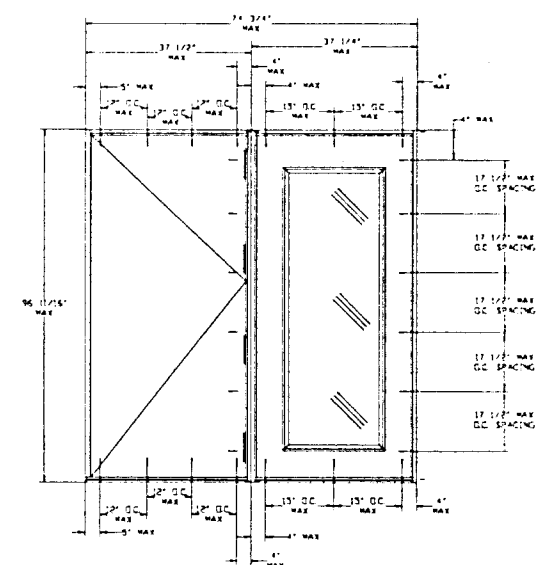

X□

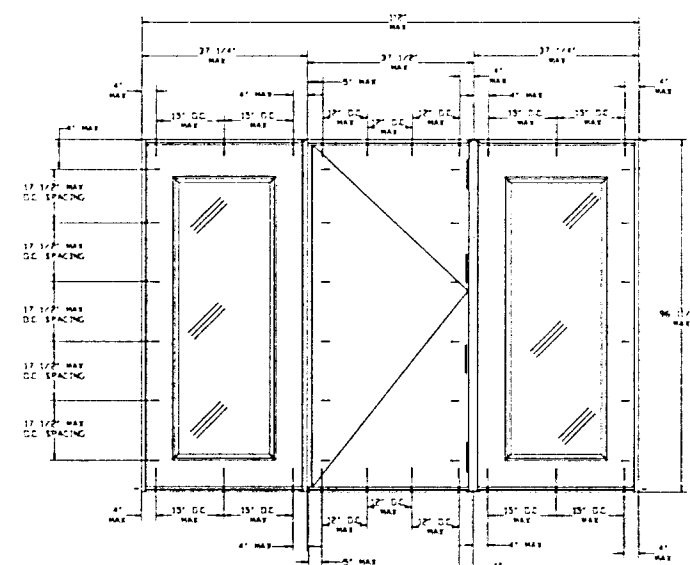

□X□

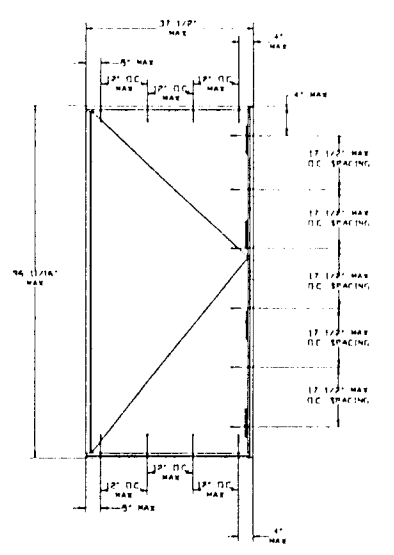

X

PRODUCT RENEWED


ACCEPTANCE No. 01-1031.04

EXPIRATION DATE November 5, 2006





By [Signature]
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

| | | | |
|---|---------------|--------------|---------|
| LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. : | | | |
| EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S | | | |
| ENGINEER: | LTR. | REVISIONS | DATE BY |
| DR. BY: J.D. | DATE: 7/30/01 | PART NAME: | |
| PREMDOR ENTRY SYSTEMS | | SCALE: | |
| 911 E. JEFFERSON | | 31-1034-EM-□ | |
| PITTSBURG, KS. 66762 | | SHEET 5 OF 6 | |
| REVISION LETTER | | | |

OTHER DOOR PANEL STYLES

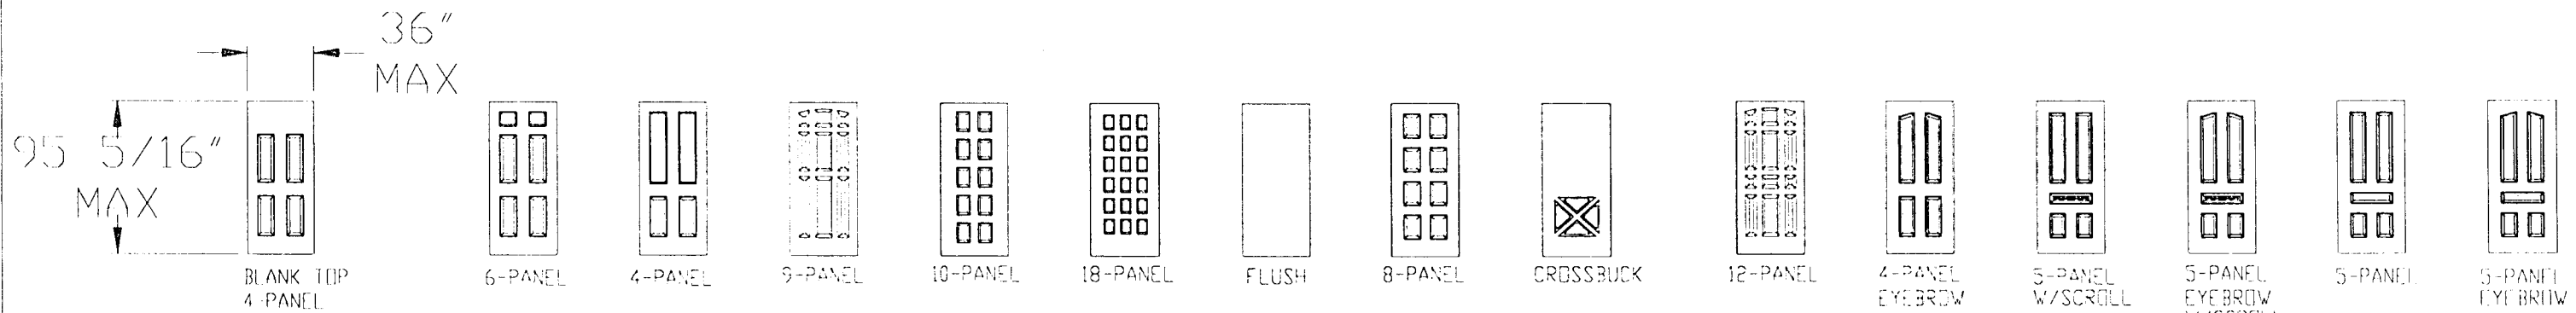

OTHER SIDELITE STYLES

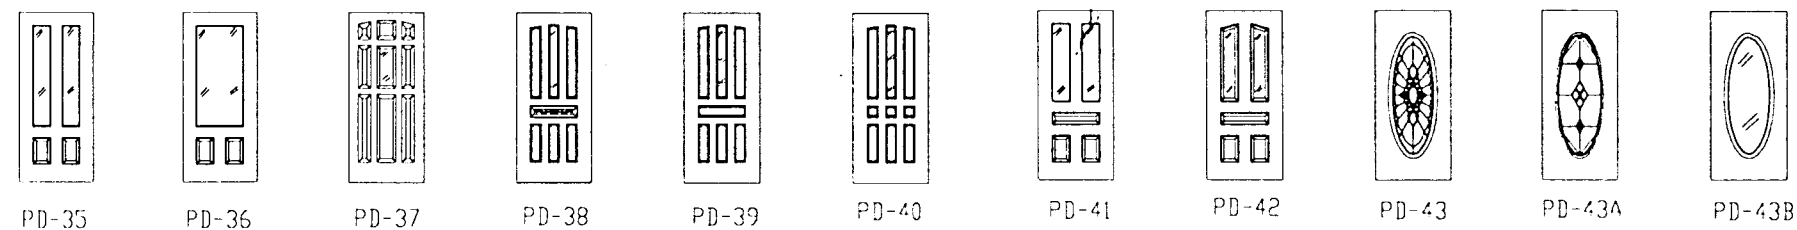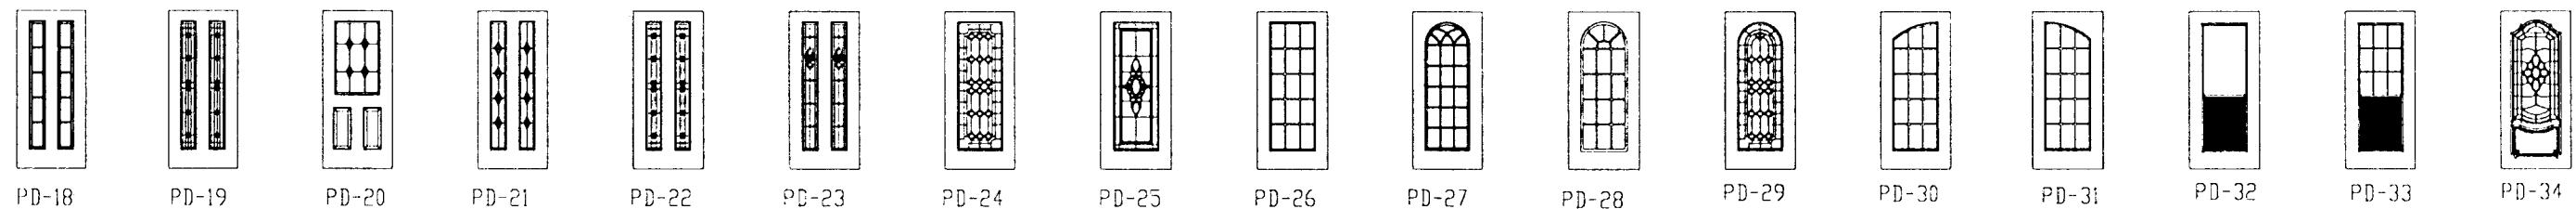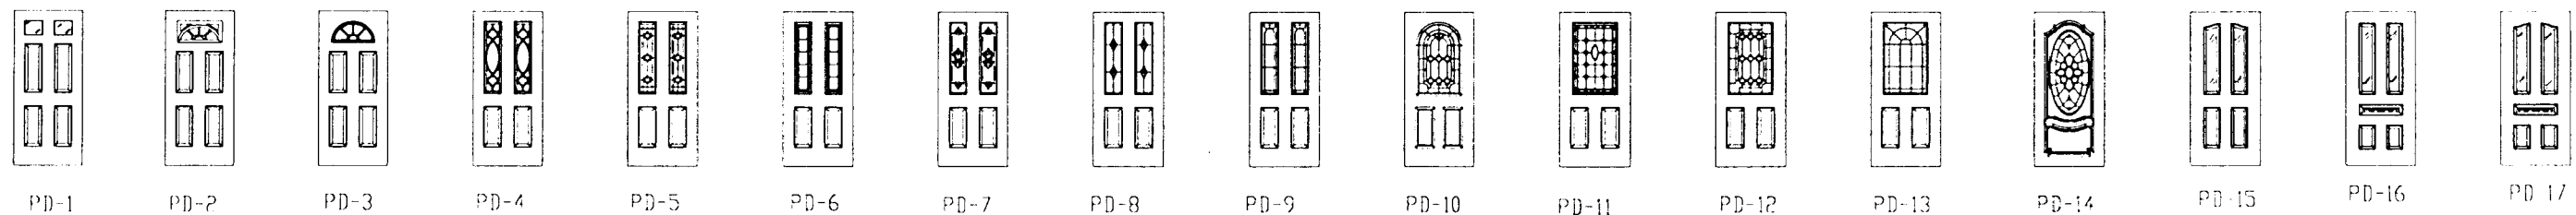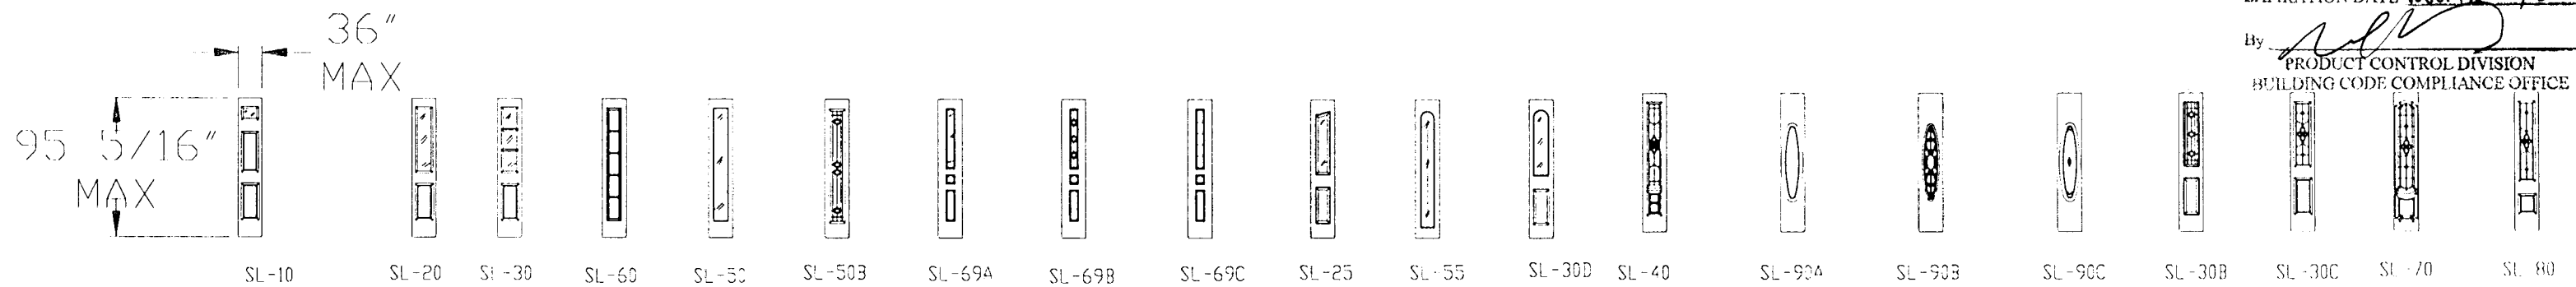

PRODUCT RENEWED

ACCEPTANCE No. 01-1031.04

EXPIRATION DATE November 5, 2006

By 
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

| | | | |
|--|--|---------------------------------|-----------|
| LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. : | | | |
| EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S. | | | |
| ENGINEER: | | LTR. | REVISIONS |
| DR BY: J.D. | | PART NAME: PREMDOR DOOR OPTIONS | |
| DATE: 7/30/01 | | MAT'L: | SCALE: |
| PREMDOR ENTRY SYSTEMS | | 31-1034-EM-D | |
| 911 E. JEFFERSON | | SHEET 6 OF 6 | |
| PITTSBURG, KS 66762 | | | |
| | | REVISION LETTER | |